


Job No.: File :CE	Phase: N
Standard: EN 55032 Class A Conduction (QP)	Power Source: AC 120V/60Hz
Test item: Conduction Test	Date: 19/11/07/
Temp.(°C)/Hum.(%): 26°C / 60 %	Time: 10/50/47
EUT:	Engineer
Model: CTN-1261C	
Mode:	


Note:

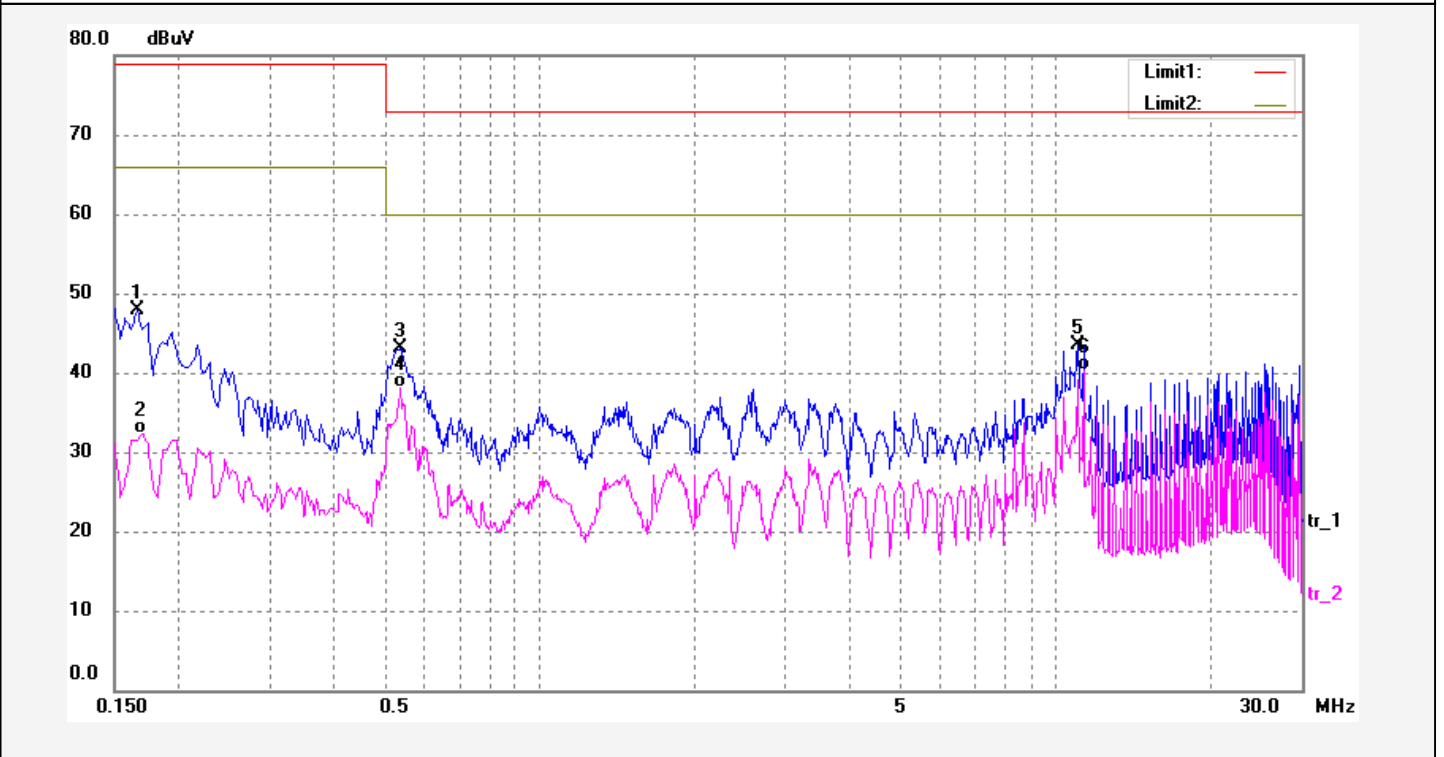

No.	Freq. (MHz)	Reading (dBuV)	Factor (dB)	Result (dBuV)	Limit dBuV	Margin (dB)	Detector	Remark
1	0.1660	37.95	9.95	47.90	79.00	-31.10	peak	
2	0.1700	22.38	9.95	32.33	66.00	-33.67	AVG	
3	0.5380	32.99	10.03	43.02	73.00	-29.98	peak	
4	0.5380	28.13	10.03	38.16	60.00	-21.84	AVG	
5	11.0219	32.99	10.58	43.57	73.00	-29.43	peak	
6*	11.3580	29.76	10.58	40.34	60.00	-19.66	AVG	

Job No.: File :CE	Phase: L1
Standard: EN 55032 Class A Conduction (QP)	Power Source: AC 120V/60Hz
Test item: Conduction Test	Date: 19/11/07/
Temp.(°C)/Hum.(%): 26°C / 60 %	Time: 10/53/14
EUT:	Engineer
Model: CTN-1261C	
Mode:	

Note:

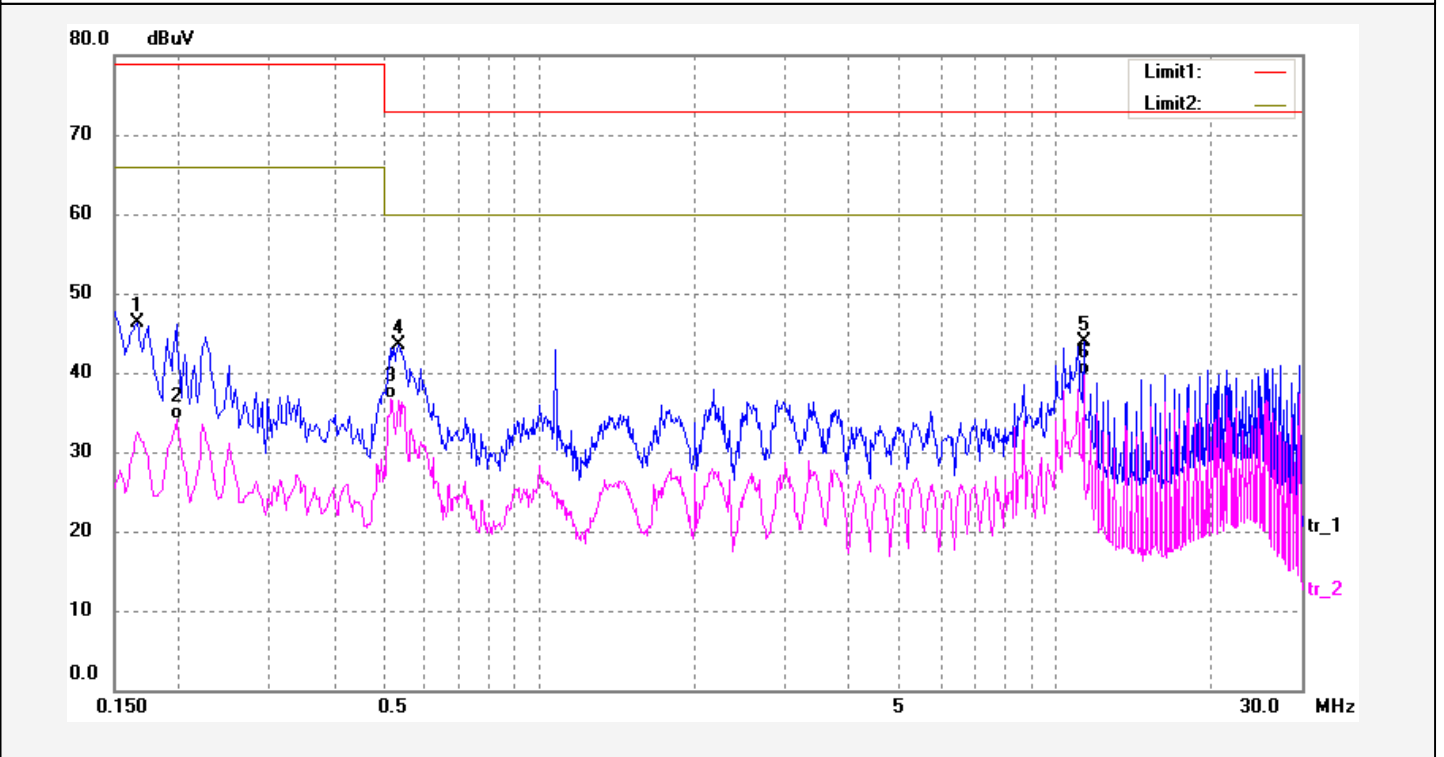

No.	Freq. (MHz)	Reading (dBuV)	Factor (dB)	Result (dBuV)	Limit dBuV	Margin (dB)	Detector	Remark
1	0.1660	36.33	9.95	46.28	79.00	-32.72	peak	
2	0.1980	24.11	9.97	34.08	66.00	-31.92	AVG	
3	0.5180	26.72	10.02	36.74	60.00	-23.26	AVG	
4	0.5340	33.42	10.03	43.45	73.00	-29.55	peak	
5	11.3620	33.36	10.58	43.94	73.00	-29.06	peak	
6*	11.3620	29.15	10.58	39.73	60.00	-20.27	AVG	